

FRAMELESS HARDWARE COMPANY LLC ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 SOUND TRANSMISSION LOSS TESTING ON AN ASPIRE HD DOOR

REPORT NUMBER

T6274.01-303-11-R0

TEST DATE

04/07/26

ISSUE DATE

06/09/26


PAGES

15

DOCUMENT CONTROL NUMBER

RT-R-AMER-Test-2761 (08/20/25)

© 2017 INTERTEK

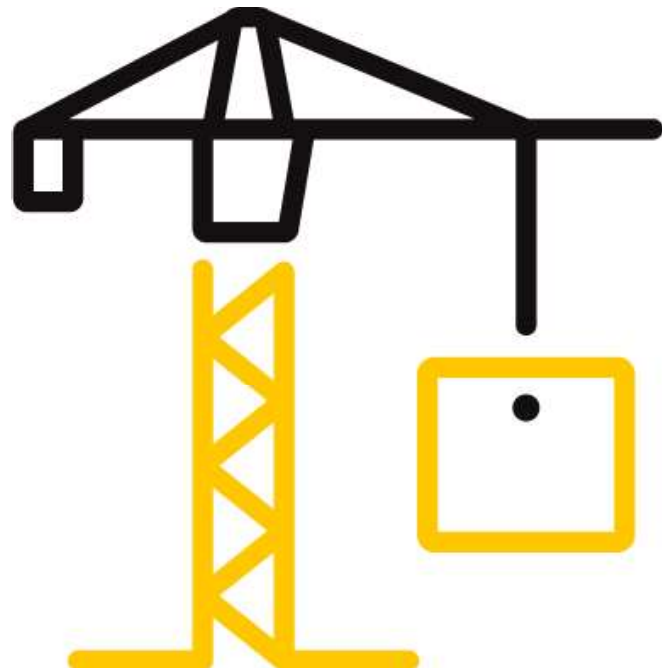

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

REPORT ISSUED TO

FRAMELESS HARDWARE COMPANY LLC

2323 Firestone Blvd
South Gate, CA 90280

SECTION 1

SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Frameless Hardware Company LLC to conduct a sound transmission loss test. Results obtained are tested values and were secured by using the designated test methods. The complete test data is included herein. The client provided the test specimen. All measurements were conducted in the HT test chambers at Intertek B&C located in Lake Forest, CA.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

For INTERTEK B&C:

COMPLETED BY	Yahya Paya	REVIEWED BY	Todd D. Kister
TITLE	Acoustic Lab Manager Acoustical Testing	TITLE	Senior Regional Manager Acoustical Testing
SIGNATURE	 Digitally Signed by: Yahya Paya	SIGNATURE	 Digitally Signed by: Todd D. Kister
DATE	06/09/26	DATE	06/09/26

YP:lcr

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the U.S. Government.



Lab Code 600258-0

This page alone is not a complete report.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 2

SUMMARY OF TEST RESULTS

SERIES/MODEL	Aspire HD
TYPE	Door system
GLAZING (NOMINAL)	1" IG (3/16" tempered exterior, 3/8" airspace, 7/16" laminated interior); 75F glass temperature
DATA FILE NO.	T6274.01A
STC	38
OITC	32

SECTION 3

TEST METHODS

The specimens were evaluated in accordance with the following:

ASTM E90-23, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements*

ASTM E413-22, *Classification for Rating Sound Insulation*

ASTM E1332-22, *Standard Classification for Rating Outdoor-Indoor Sound Attenuation*

ASTM E2235-04 (2020), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

SECTION 4

SPECIMEN INSTALLATION

A sound transmission loss test was initially performed on a filler wall.

The specimen plug was removed from the filler wall assembly. The specimen was placed on an isolation pad in the test opening. Duct seal was used to seal the perimeter of the specimen to the test opening on both sides. The interior side of the specimen, when installed, was approximately 1/4" from being flush with the receive room side of the filler wall. A stethoscope was used to check for any abnormal air leaks around the test specimen prior to testing. Operable portions of the test specimen, if any, were cycled at least five times prior to testing.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

**SECTION 5
EQUIPMENT**

The equipment listed below meets the requirements of the test methods stated in Section 3 of this report.

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE
Data Acquisition Card	National Instruments	PXIe-4464	Data Acquisition Card*	INT00837	09/25
Data Acquisition Card	National Instruments	PXIe-4464	Data Acquisition Card*	INT00625	07/25
Data Acquisition Card	National Instruments	PXIe-4464	Data Acquisition Card*	INT00396	09/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00235	10/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00234	10/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00236	10/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00237	10/25
Source Room Microphone	PCB piezotronics	378C20	Microphone and Preamplifier	INT00238	10/25
Receive Room Microphone	PBC Piezotronics	378C20	Microphone and Preamplifier	INT00239	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00240	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00241	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00242	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00243	05/25
Receive Room Environmental Indicator	Comet	T7510	Receive Room	INT00300	07/25
Source Room Environmental Indicator	Comet	T7510	Source Room	INT00299	07/25
Microphone Calibrator	Norsonic	1251	Pistonphone Calibrator	INT00288	06/25

*- Note: The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

TEST CHAMBER

	VOLUME	DESCRIPTION
RECEIVE ROOM	231 m ³	Rotating vane and stationary diffusers Temperature and humidity controlled Isolation pads under the floor
SOURCE ROOM	196 m ³	Stationary diffusers only Temperature and humidity controlled

	MAXIMUM SIZE	DESCRIPTION
TL TEST OPENING	4.27 m wide by 3.05 m high	Vibration break between source and receive rooms

N/A-Not Applicable

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 6

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Mario Salazar	Frameless Hardware Company LLC
Marco Ramirez	Frameless Hardware Company LLC
Michael Richie	Intertek B&C
Yahya Paya	Intertek B&C

SECTION 7

TEST PROCEDURE

The sensitivity of the microphones was checked before measurements were conducted.

The transmission loss values were obtained for a single direction of measurement.

Two background noise sound pressure levels and five sound absorption measurements were conducted at each of five microphone positions.

Two sound pressure level measurements were made simultaneously in receive and source rooms at each of five microphone positions.

The air temperature and relative humidity conditions were monitored and recorded during all measurements.

Data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

Intertek B&C will save photographs of the sampled test specimens.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 8

ACOUSTICAL TEST CALCULATIONS

Transmission loss (TL) at each 1/3 octave frequency is the average source room sound pressure level minus the average receive room sound pressure level, plus, 10 times the log of the specimen area divided by the sound absorption of the receive room with the sample in place.

STC Rating

To obtain the Sound Transmission Class (STC), read the TL of the contour curve at 500 Hz. The sum of the deficiencies below the contour curve must not exceed 32. The maximum deficiency at any one frequency must not exceed 8.

OITC Rating

The Outdoor-Indoor Transmission Class (OITC) is calculated by subtracting the logarithmic summation of the TL values from the logarithmic summation of the A-weighted transportation noise spectrum stated in ASTM E1332.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 9

SPECIMEN DESCRIPTION

	FRAME	VENT
SIZE	39-1/2" by 84"	35-3/8" by 68-1/8"
THICKNESS	2-7/8"	2-3/8"
CORNERS	Mitered	Mitered
FASTENERS	Screws	Screws
SEAL METHOD	N/A	N/A
MATERIAL	Aluminum	Aluminum
REINFORCEMENT	N/A	N/A
THERMAL BREAK MATERIAL	Polyamide 66 with glass-fiber reinforced	Polyamide 66 with glass-fiber reinforced
DAYLIGHT OPENING SIZE	N/A	34-1/4" by 68-1/8"

MEASURED OVERALL INSULATION GLASS UNIT THICKNESS	1.012 "
SPACER TYPE	Black Aluminum

	EXTERIOR SHEET	GAP	INTERIOR SHEET
MEASURED THICKNESS	0.182"	0.392"	0.438"
MUNTIN PATTERN	N/A	N/A	N/A
MATERIAL	Tempered	Air*	Laminated tempered
LAMINATE MATERIAL	N/A	N/A	QS 41 (Acoustical) PVB*

GLAZING METHOD	Channel
GLAZING MATERIAL	Aluminum with EPDM

* - Stated per Client/Manufacturer, N/A-Not Applicable

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

	TYPE	QUANTITY	LOCATION
WEATHERSTRIP	Bulb gasket	1 Row	Head, jambs, stile towards locks
	Center fin pile	2 Rows	Top rail
	Center fin pile	1 Row	Bottom rail
	Drop seal	1	Bottom rail
HARDWARE	Dual purpose bottom pivot	1	Jamb
	Top pivot	1	Jamb
	Cylinder lock	2	Top and Bottom rails
	Keeper	2	Head and sill
	Pemko thermally broken Threshold 273x224	1	Sill
DRAINAGE	No drainage		

TOTAL WEIGHT (lbs)	AVERAGE WEIGHT (lbs/ft ²)
252.63	11.40

Photographs are included in Section 11.

A drawing of the test specimen is included in Section 12.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 10

TEST RESULTS

ASTM E90 AIRBORNE SOUND TRANSMISSION LOSS



Lab Code 600258-0

TEST DATE	04/07/26				
DATA FILE NO.	T6274.01A				
CLIENT	Frameless Hardware Company LLC				
DESCRIPTION	Aspire HD door system with 1" IG (3/16" tempered exterior, 3/8" airspace, 7/16" laminated interior); glass temperature 75F				
SPECIMEN AREA	2.14 m ²	RECEIVE TEMP.	23.6 °C	SOURCE TEMP.	23.5 °C
TECHNICIAN	Michael Rich	RECEIVE HUMIDITY	45%	SOURCE HUMIDITY	49%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION (m ²)	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% SAMPLING LIMIT (dB)	NUMBER OF DEFICIENCIES
80	25.7	5.1	96	68	26	3.41	-
100	23.1	5.4	95	66	26	2.38	-
125	37.4	4.9	98	67	28	2.72	0
160	24.2	4.3	100	69	28	1.59	0
200	22.2	5.6	102	73	24	0.95	4
250	19.6	6.3	103	70	28	1.03	3
315	24.5	6.8	105	70	30	1.25	4
400	19.0	6.3	106	69	33	1.26	4
500	17.3	5.5	104	66	34	1.12	4
630	19.4	5.8	104	64	36	0.34	3
800	23.4	6.0	103	61	38	0.55	2
1000	10.2	6.0	105	61	39	0.55	2
1250	10.5	6.3	103	58	41	0.41	1
1600	8.3	6.8	101	55	41	0.55	1
2000	9.4	8.0	98	50	42	0.33	0
2500	7.0	8.8	98	52	40	0.24	2
3150	7.7	10.0	99	53	40	0.52	2
4000	8.1	12.2	98	49	42	0.60	0
5000	8.9	15.2	94	41	44	0.81	-
STC RATING	38 (Sound Transmission Class)						
DEFICIENCIES	32 (Sum of Deficiencies)						
OITC RATING	32 (Outdoor-Indoor Transmission Class)						

- Notes:**
- 1) Receive Room levels less than 6 dB above the Background levels are red.
 - 2) Specimen TL levels listed in red indicate the lower limit of the transmission loss.
 - 3) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0


Date: 06/09/26

ASTM E90 AIRBORNE SOUND TRANSMISSION LOSS



Lab Code 600258-0

TEST DATE	04/07/26				
DATA FILE NO.	T6274.01A				
CLIENT	Frameless Hardware Company LLC				
DESCRIPTION	Aspire HD door system with 1" IG (3/16" tempered exterior, 3/8" airspace, 7/16" laminated interior); glass temperature 75F				
SPECIMEN AREA	2.14 m ²	RECEIVE TEMP.	23.6 °C	SOURCE TEMP.	23.5 °C
TECHNICIAN	Michael Rich	RECEIVE HUMIDITY	45%	SOURCE HUMIDITY	49%

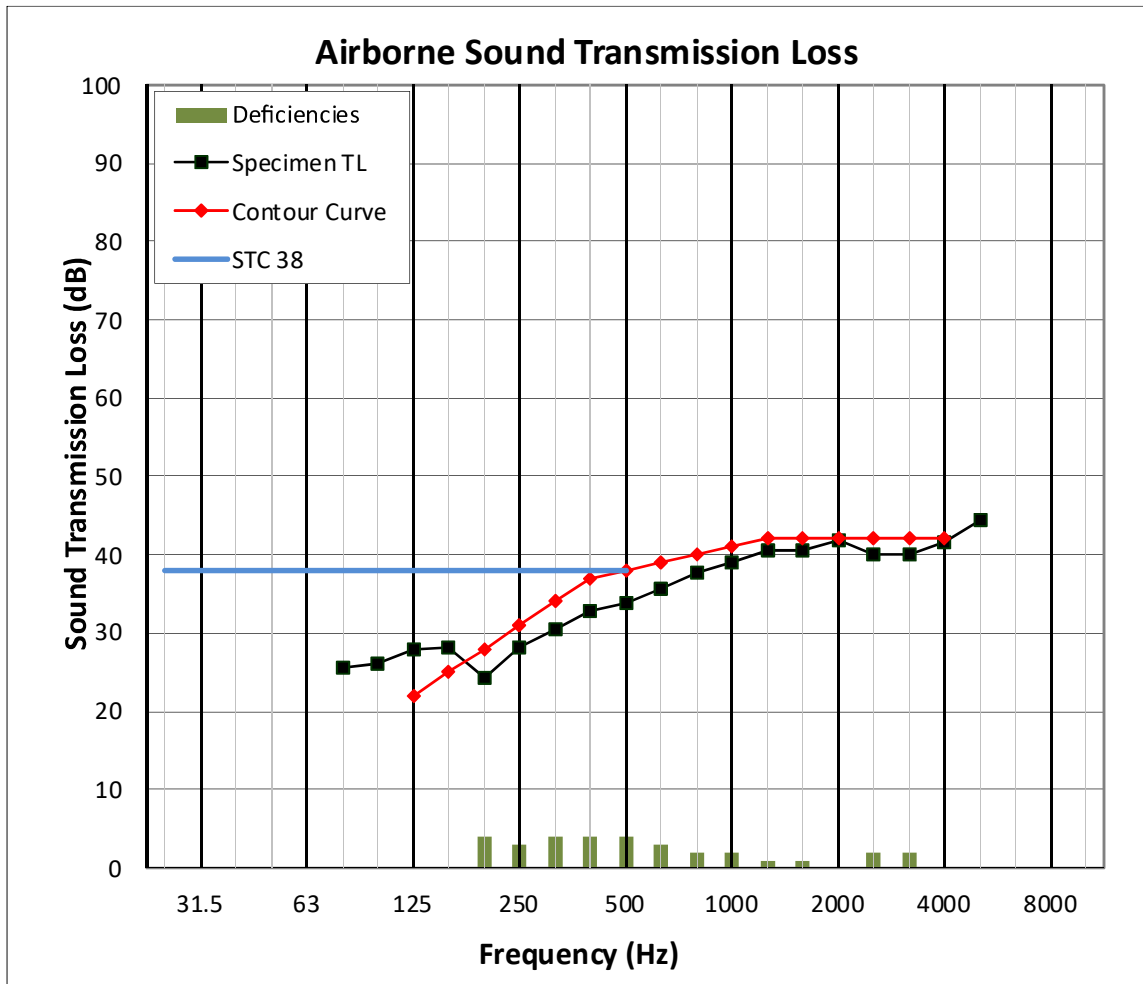

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 11

PHOTOGRAPHS

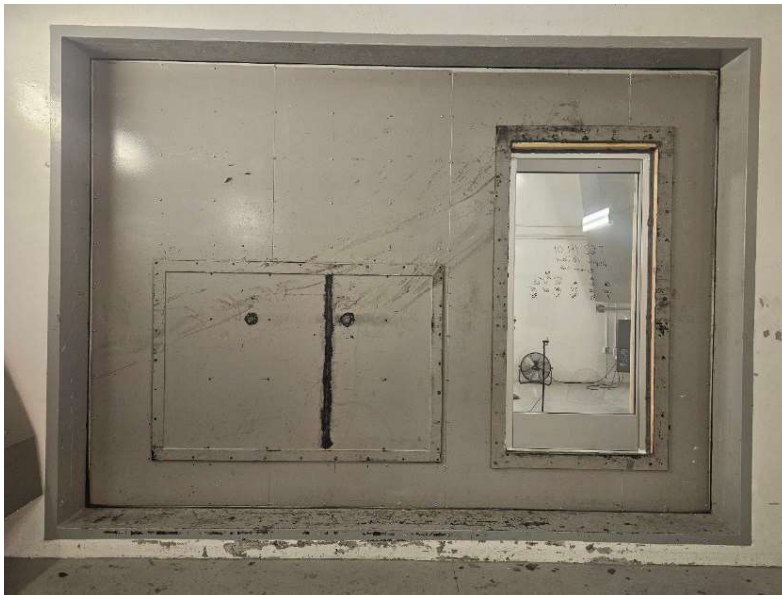


Photo No. 1
Receive Room View of Installed Specimen



Photo No. 2
Source Room View of Installed Specimen

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 12 DRAWING

BILL OF MATERIALS			
TYPE	ITEM	PART NUMBER	DESCRIPTION
	F1	ASHDUAMBDU	ASPIRE HD DOOR JAMB DARK BRONZE ANODIZE
	F2	273X24FOT	ASPIRE HD PEMO 273X24 THRESHOLD
DOOR	D1	ASVDSGOMPOU	ASPIRE VERTICAL DOOR STYLE HOUSING 1" I.G. DARK BRONZE
	D2	ASVDSGDFOMPDU	ASPIRE HD VERTICAL DOOR STYLE DARK BRONZE
	D3	ASR4CZMPDU	ASPIRE 4" DOOR RAIL HOUSING 1" I.G. COMPOSITE DARK BRONZE
	D4	ASRCAMDU	ASPIRE DOOR RAIL CONTROL MEMBER 1" I.G. DARK BRONZE
	D5	ASRIGCDU	ASPIRE DOOR RAIL GLASS CLAMP 1" I.G. DARK BRONZE
	D6	ASVDSGDCDU	ASPIRE VERTICAL DOOR STYLE GLASS CLAMP 1" I.G. DARK BRONZE
	D7	ASR10COMPOU	ASPIRE 10" DOOR RAIL HOUSING 1" I.G. COMPOSITE DARK BRONZE
CLAD	C1	ASHDUJCLD1SA	ASPIRE HD DOOR JAMB CLAD 1 CLEAR ANODIZE
	C2	ASHDUJCLD2SA	ASPIRE HD DOOR JAMB CLAD 2 CLEAR ANODIZE
	C3	ASHDUJCLD3SA	ASPIRE HD DOOR JAMB CLAD 3 CLEAR ANODIZE
	C4	ASHDUJCLD4SA	ASPIRE HD DOOR JAMB CLAD 4 CLEAR ANODIZE
	C5	ASR4RCLDRA	ASPIRE 4" DOOR RAIL CLAD 1" I.G. CLEAR ANODIZE
	C6	ASVDSGLD5A	ASPIRE VERTICAL DOOR STYLE CLAD 1" I.G. CLEAR ANODIZE
	C7	ASVDSRECTLD5A	ASPIRE VERTICAL DOOR STYLE RECTANGULAR CLAD 1" I.G. CLEAR ANODIZE
	C8	AS10DRCL8SA	ASPIRE 10" DOOR RAIL HOUSING 1" I.G. COMPOSITE DARK BRONZE
GASKET	G1	ASR18BSL	ASPIRE BULB SEAL FOR VERTICAL MULLIONS
	G2	AVDSJ01	ASPIRE VERTICAL DOOR STYLE CLAMP GASKET
	G3	AR41DU01	ASPIRE DOOR RAIL 1" I.G. CLAMP GASKET
	G4	9120	BLACK HEAVY DENSITY QUIET CENTER FIN PILE (0.187" X 0.387")
HARDWARE	H1	RCT105A	FHC MORTISE KEYS CYLINDER W/ 3MM TRIM RING SATIN ANODIZE
	H2	R777S	FHC STANDARD DOOR RAIL FLOOR LOCK 11/16 THROW
	H3	DPS18S	FHC DUST PROOF KEEPER NON-LOCKING WITH PLATE BRUSHED STAINLESS STEEL
	H4	PLA2006	PLANET DROP SEAL 90MM (37.79")
	H5	8134ATCA	FHC ASPIRE HD CONTINUOUS HINGE CLEAR ANODIZE
SCREWS	S1	ASDRCFST	3/8"-16 X 1-1/4" CUP POINT SET SCREW 18-8 STAINLESS ASPIRE DOOR RAIL CLAMPING FASTENER - WITH NYLON PATCH
	S2	ASDFST	ASPIRE 3/8-18 X 1-1/2" LOW PROFILE SOCKET CAP SCREW 18-8 STAINLESS STEEL
	S3	ASBCFST	ASPIRE CORNER BLOCK FASTENERS W/PATCH
	S4	ASVDSGCFST	ASPIRE #10-24 X 1/2" CONE POINT SET SCREW 18-8 STAINLESS STEEL W/ NYLON PATCH
	S5	ASCBFST	ASPIRE 1/4" X 3/8" SOCKET CAP SCREW 18-8 STAINLESS - CORNER BLOCK FASTENERS
	S6	895EAB90	#12 X 3" LONG PHILLIPS PAN HEAD SCREW FOR WOOD 18-8 STAINLESS STEEL
	S7	124494PT1M0	#12-24 X 3/4" LONG PHILLIPS FLAT HEAD MASH HSC SCREW 18-8 STAINLESS STEEL
MSG	M1	AS1AGLS	1" THICK INSULATED TEMP GLASS PANEL 3/16" CLEAR TEMP X 3/8" AIR SPACER X 3/16" CLEAR TEMP 600" GS 41 (ACOUSTICAL) PVB 3/16" CLEAR TEMP
	M2	VDSSCAP	ASPIRE WEATHER STRIP CAP
	M3	AS10FPHBLK	ASPIRE DOOR JACK PUSHIN BLOCK
	M4	AS10RNLKAC	DOOR CORNER BLOCK FOR ALUMINUM CLADDED ASPIRE DOOR
	M5	VHB110	PVC VHB ADHESIVE TAPE 610 X 1"
	M6	VHB1240	710 X 340 X 108 ACRYLIC VERY H-BOND ADHESIVE TAPE
	M7	VHB12140	ACRYLIC VHB ADHESIVE TAPE 240 X 1 1/2"
	M8	ISBN2	FHC 1/8" X 1-1/8" X 4" BLACK SILICONE 60 DUROMETER SETTING BLOCK
	M9	COBRHC	FHC BARRIER IRIS CLOSED CELL 1/4" DIA
	M10	DC798BL	FHC 795 DOW CORNING SILICONE BUILDING SEALANT - BLACK
	M11	S100C	FHC S100 SERIES ACETIC CURE SILICONE SEALANT - CLEAR



FHC
Framing Hardware Company

DESIGNER STAMP

ACOUSTIC

DATE: 06/08/2026

BY: [Signature]


FOR: [Signature]

SCALE: 0.01

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0



Date: 06/09/26

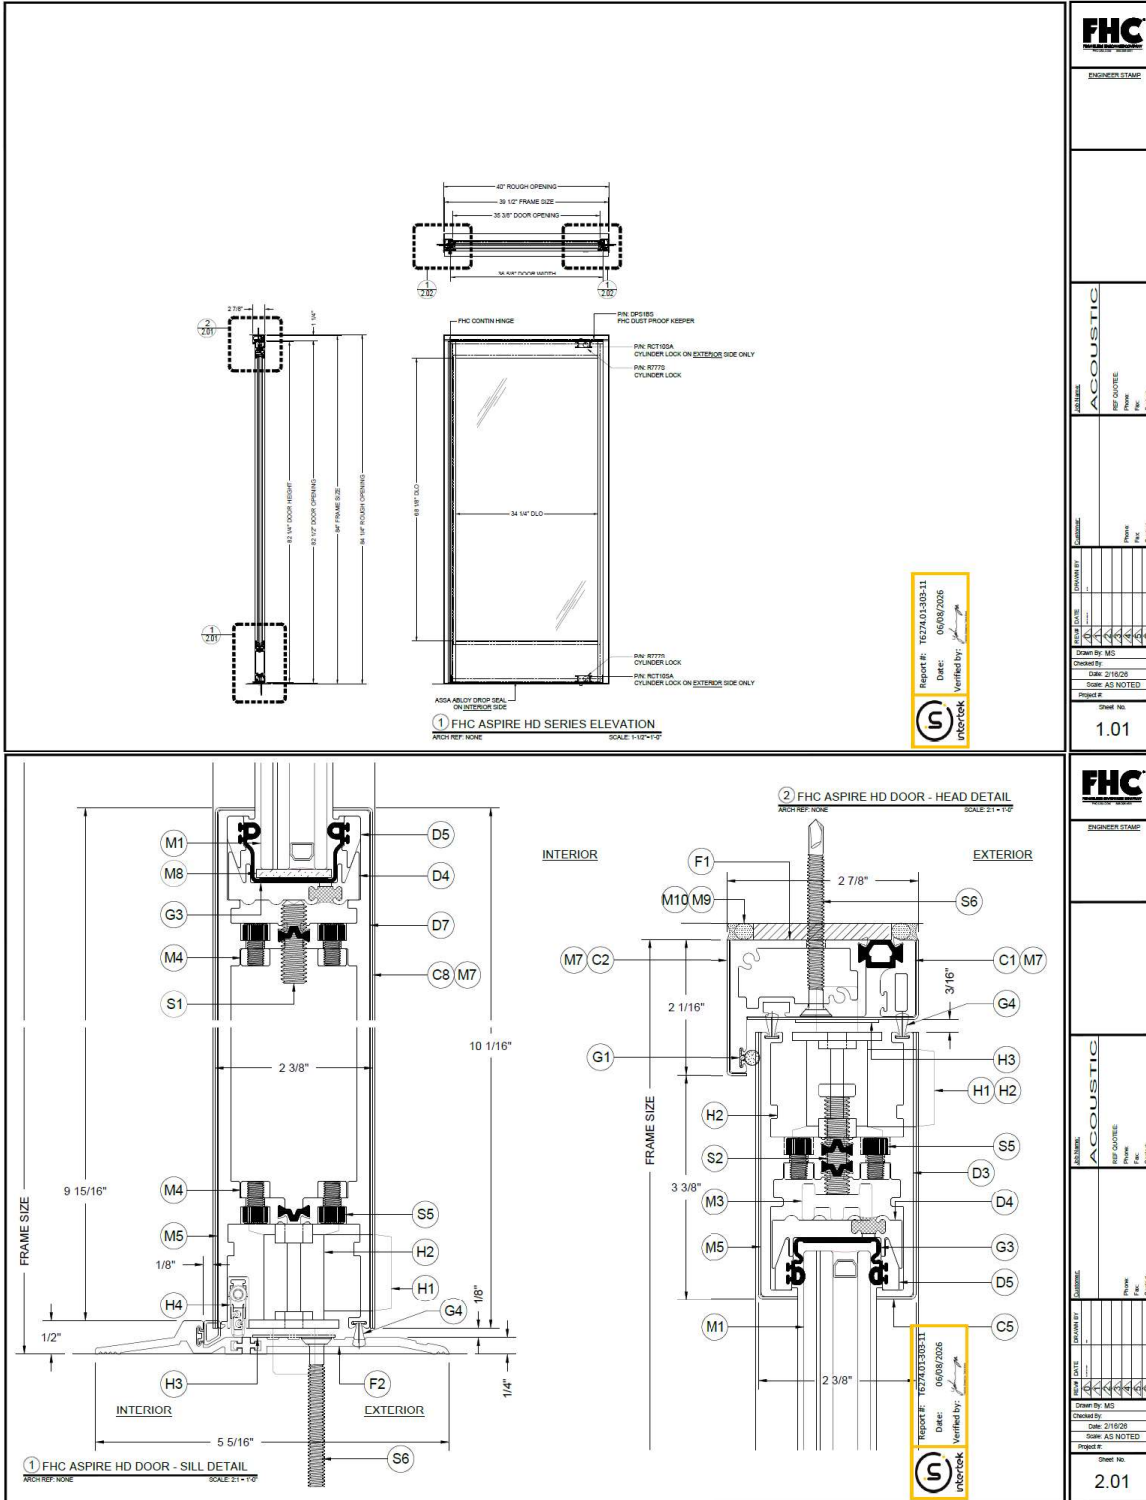

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

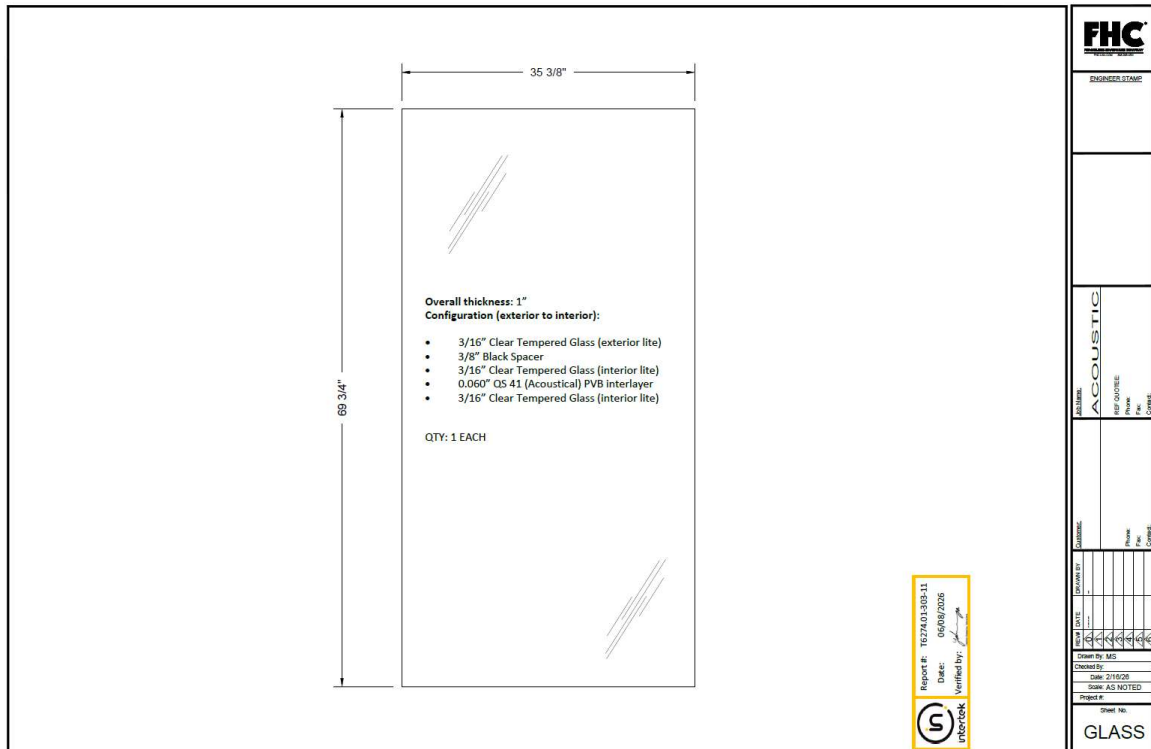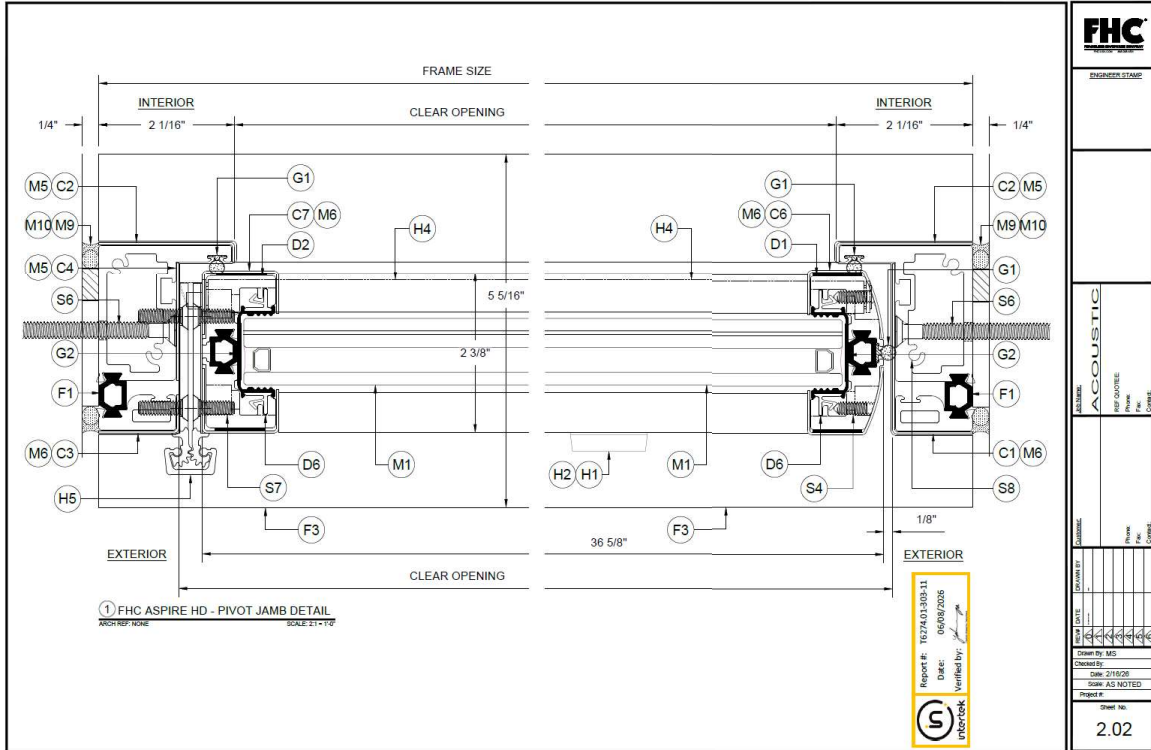



Total Quality. Assured.

25800 Commercentre Drive
Lake Forest, California 92630

Telephone: 949-460-9600
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6274.01-303-11-R0

Date: 06/09/26

SECTION 13

REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	06/09/26	N/A	Original Report Issue