

FRAMELESS HARDWARE COMPANY LLC ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 SOUND TRANSMISSION LOSS TESTING ON AN ASPIRE DOOR SYSTEM

REPORT NUMBER

T6273.01-303-11-R1

TEST DATE

04/06/26

ISSUE DATE

05/20/26

REVISE DATE

05/28/26


PAGES

17

DOCUMENT CONTROL NUMBER

RT-R-AMER-Test-2761 (08/20/25)

© 2017 INTERTEK

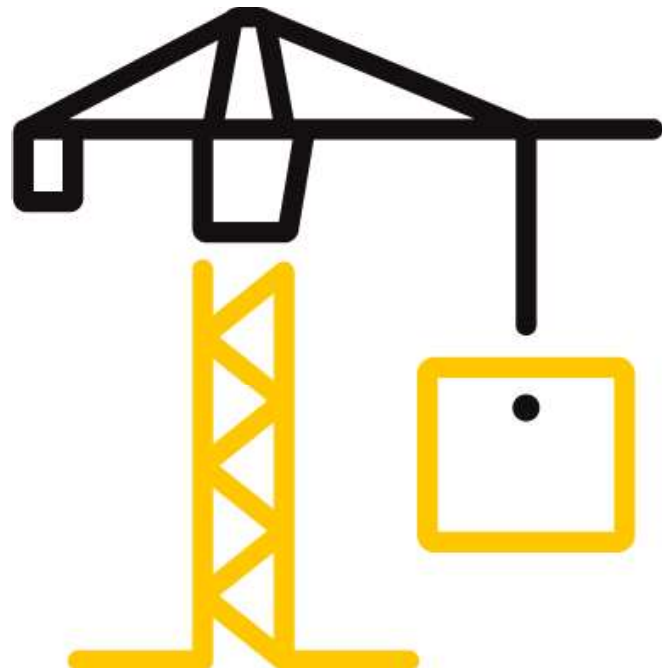

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

REPORT ISSUED TO

FRAMELESS HARDWARE COMPANY LLC

2323 Firestone Blvd
South Gate, CA 90280

SECTION 1


SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Frameless Hardware Company LLC to conduct a sound transmission loss test. Results obtained are tested values and were secured by using the designated test methods. The complete test data is included herein. The client provided the test specimen. All measurements were conducted in the HT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

For INTERTEK B&C:

COMPLETED BY	Yahya Paya	REVIEWED BY	Todd D. Kister
TITLE	Acoustic Lab Manager Acoustical Testing	TITLE	Senior Regional Manager Acoustical Testing
SIGNATURE	 Digitally Signed by: Yahya Paya	SIGNATURE	 Digitally Signed by: Todd D. Kister
DATE	05/28/26	DATE	05/28/26

YP:lcr

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the U.S. Government.



Lab Code 600258-0

This page alone is not a complete report.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 2

SUMMARY OF TEST RESULTS

SERIES/MODEL	Aspire
TYPE	Door system
GLAZING	1-1/32" IG (7/16" laminated exterior, 13/32" air space, 3/16" tempered interior); 75F glass temperature
DATA FILE NO.	T6273.01C
STC	34
OITC	31

SECTION 3

TEST METHODS

The specimens were evaluated in accordance with the following:

ASTM E90-23, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements*

ASTM E413-22, *Classification for Rating Sound Insulation*

ASTM E1332-22, *Standard Classification for Rating Outdoor-Indoor Sound Attenuation*

ASTM E2235-04 (2020), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

SECTION 4

SPECIMEN INSTALLATION

A sound transmission loss test was initially performed on a filler wall.

The specimen plug was removed from the filler wall assembly. The specimen was placed on an isolation pad in the test opening. Duct seal was used to seal the perimeter of the specimen to the test opening on both sides. The interior side of the specimen, when installed, was approximately 1/4" from being flush with the receive room side of the filler wall. A stethoscope was used to check for any abnormal air leaks around the test specimen prior to testing. Operable portions of the test specimen, if any, were cycled at least five times prior to testing.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 5

EQUIPMENT

The equipment listed below meets the requirements of the test methods stated in Section 3 of this report.

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE
Data Acquisition Card	National Instruments	PXIe-4464	Data Acquisition Card*	INT00837	09/25
Data Acquisition Card	National Instruments	PXIe-4464	Data Acquisition Card*	INT00625	07/25
Data Acquisition Card	National Instruments	PXIe-4464	Data Acquisition Card*	INT00396	09/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00235	10/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00234	10/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00236	10/25
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00237	10/25
Source Room Microphone	PCB piezotronics	378C20	Microphone and Preamplifier	INT00238	10/25
Receive Room Microphone	PBC Piezotronics	378C20	Microphone and Preamplifier	INT00239	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00240	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00241	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00242	05/25
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	INT00243	05/25
Receive Room Environmental Indicator	Comet	T7510	Receive Room	INT00300	07/25
Source Room Environmental Indicator	Comet	T7510	Source Room	INT00299	07/25
Microphone Calibrator	Norsonic	1251	Pistonphone Calibrator	INT00288	06/25

*- Note: The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

TEST CHAMBER

	VOLUME	DESCRIPTION
RECEIVE ROOM	231 m ³	Rotating vane and stationary diffusers Temperature and humidity controlled Isolation pads under the floor
SOURCE ROOM	196 m ³	Stationary diffusers only Temperature and humidity controlled

	MAXIMUM SIZE	DESCRIPTION
TL TEST OPENING	4.27 m wide by 3.05 m high	Vibration break between source and receive rooms

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 6

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Mario Salazar	Frameless Hardware Company LLC
Marco Ramirez	Frameless Hardware Company LLC
Michael Richie	Intertek B&C
Yahya Paya	Intertek B&C

SECTION 7

TEST PROCEDURE

The sensitivity of the microphones was checked before measurements were conducted.

The transmission loss values were obtained for a single direction of measurement.

Two background noise sound pressure levels and five sound absorption measurements were conducted at each of five microphone positions.

Two sound pressure level measurements were made simultaneously in receive and source rooms at each of five microphone positions.

The air temperature and relative humidity conditions were monitored and recorded during all measurements.

Data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

Intertek B&C will save photographs of the sampled test specimens.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 8

ACOUSTICAL TEST CALCULATIONS

Transmission loss (TL) at each 1/3 octave frequency is the average source room sound pressure level minus the average receive room sound pressure level, plus, 10 times the log of the specimen area divided by the sound absorption of the receive room with the sample in place.

STC Rating

To obtain the Sound Transmission Class (STC), read the TL of the contour curve at 500 Hz. The sum of the deficiencies below the contour curve must not exceed 32. The maximum deficiency at any one frequency must not exceed 8.

OITC Rating

The Outdoor-Indoor Transmission Class (OITC) is calculated by subtracting the logarithmic summation of the TL values from the logarithmic summation of the A-weighted transportation noise spectrum stated in ASTM E1332.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 9

SPECIMEN DESCRIPTION

	FRAME	VENT
SIZE	39-1/2" by 84"	37-1/8" by 83-1/8"
THICKNESS	2-3/8"	2-1/2"
CORNERS	Mitered	Mitered
FASTENERS	Screws	Screws
SEAL METHOD	N/A	N/A
MATERIAL	Aluminum	Aluminum
REINFORCEMENT	N/A	N/A
THERMAL BREAK MATERIAL	Polyamide 66 with glass-fiber reinforced	Polyamide 66 with glass-fiber reinforced
DAYLIGHT OPENING SIZE	N/A	34-5/8" by 68-1/2"

MEASURED OVERALL INSULATION GLASS UNIT THICKNESS	1.022"
SPACER TYPE	Black Aluminum

	EXTERIOR SHEET	GAP	INTERIOR SHEET
MEASURED THICKNESS	0.438"	0.401"	0.189"
MUNTIN PATTERN	N/A	N/A	N/A
MATERIAL	Laminated	Air*	Tempered
LAMINATE MATERIAL	N/A	N/A	N/A

GLAZING METHOD	Pressured
GLAZING MATERIAL	Aluminum with EPDM

* - Stated per Client/Manufacturer, N/A-Not Applicable

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

	TYPE	QUANTITY	LOCATION
WEATHERSTRIP	Bulb gasket	1 Row	Stiles
	Center fin pile	2 Rows	Top rail
	Center fin pile	1 Row	Bottom rail
	Drop seal	1	Bottom rail
HARDWARE	Dual purpose bottom pivot	1	Jamb
	Top pivot	1	Jamb
	Cylinder lock	2	Top and bottom rails
	Keeper	2	Head and sill
	Thermally broken Threshold	1	Sill
DRAINAGE	No drainage		

TOTAL WEIGHT (lbs)	AVERAGE WEIGHT (lbs/ft ²)
235.28	10.21

Photographs are included in Section 11.

A drawing of the test specimen is included in Section 12.

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 10

TEST RESULTS

ASTM E90

AIRBORNE SOUND TRANSMISSION LOSS



Lab Code 600258-0

TEST DATE	04/06/26				
DATA FILE NO.	T6273.01C				
CLIENT	Frameless Hardware Company LLC				
DESCRIPTION	Aspire Door with 1-1/32" IG (7/16" laminated exterior, 13/32" airspace, 3/16" tempered interior); 75F glass temperature				
SPECIMEN AREA	2.14 m ²	RECEIVE TEMP.	23.4 °C	SOURCE TEMP.	23.2 °C
TECHNICIAN	Michael Ric	RECEIVE HUMIDITY	40%	SOURCE HUMIDITY	42%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION (m ²)	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% SAMPLING LIMIT (dB)	NUMBER OF DEFICIENCIES
80	35.1	4.4	96	69	25	3.62	-
100	31.4	5.5	96	67	26	2.12	-
125	38.1	5.6	98	68	26	2.83	0
160	31.7	4.6	100	69	27	1.34	0
200	25.9	5.4	102	74	24	0.91	0
250	20.8	6.9	103	71	26	1.03	1
315	29.5	6.9	105	70	30	1.08	0
400	20.4	6.2	106	72	30	1.45	3
500	17.0	5.4	104	69	32	1.09	2
630	19.8	5.9	104	68	32	0.51	3
800	23.3	6.0	103	66	33	0.58	3
1000	10.2	5.9	105	67	34	0.56	3
1250	7.4	6.2	103	62	36	0.44	2
1600	8.0	6.8	101	57	39	0.54	0
2000	8.1	8.1	98	52	40	0.27	0
2500	6.8	9.0	98	55	37	0.18	1
3150	7.4	10.7	99	58	34	0.51	4
4000	8.0	13.0	98	55	35	0.47	3
5000	8.7	16.4	93	49	36	0.84	-
STC RATING	34 (Sound Transmission Class)						
DEFICIENCIES	25 (Sum of Deficiencies)						
OITC RATING	31 (Outdoor-Indoor Transmission Class)						

- Notes:**
- 1) Receive Room levels less than 6 dB above the Background levels are red.
 - 2) Specimen TL levels listed in red indicate the lower limit of the transmission loss.
 - 3) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26


Date: 05/20/26

ASTM E90 AIRBORNE SOUND TRANSMISSION LOSS



Lab Code 600258-0

TEST DATE	04/06/26				
DATA FILE NO.	T6273.01C				
CLIENT	Frameless Hardware Company LLC				
DESCRIPTION	Aspire Door with 1-1/32" IG (7/16" laminated exterior, 13/32" airspace, 3/16" tempered interior); 75F glass temperature				
SPECIMEN AREA	2.14 m ²	RECEIVE TEMP.	23.4 °C	SOURCE TEMP.	23.2 °C
TECHNICIAN	Michael Ric	RECEIVE HUMIDITY	40%	SOURCE HUMIDITY	42%

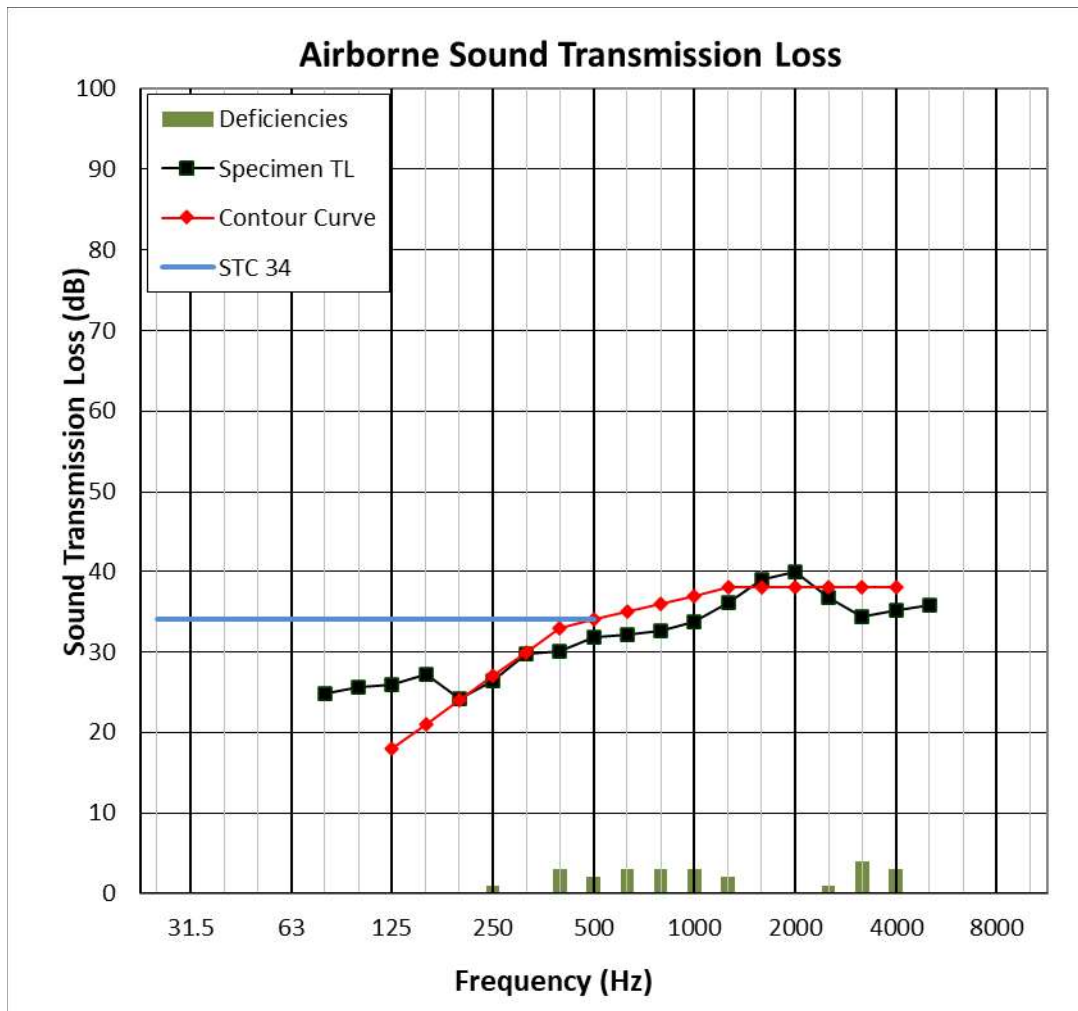

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 11

PHOTOGRAPHS

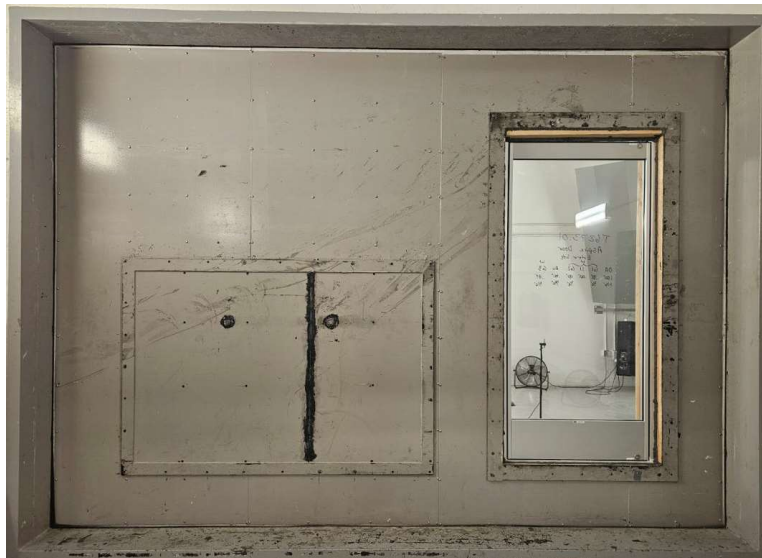


Photo No. 1
Receive Room View of Installed Specimen



Photo No. 2
Source Room View of Installed Specimen

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 12 DRAWING



BILL OF MATERIALS			
TYPE	ITEM	PART NUMBER	DESCRIPTION
FRAME	F1	ASBDRTPDU	ASPIRE HEADER FOR TOP PIVOT DARK BRONZE
	F2	ASBWDMPDU	ASPIRE DOOR JAMB AT WALL COMPOSITE DARK BRONZE
	F3	ASETHRQMPDA	ASPIRE 0" THRESHOLD COMPOSITE CLEAR ANODIZE
DOOR	D1	ASVDSQMPDU	ASPIRE VERTICAL DOOR STYLE HOUSING 1" I.G. DARK BRONZE
	D2	ASBRACMPDU	ASPIRE 4" DOOR RAIL HOUSING 1" I.G. COMPOSITE DARK BRONZE
	D3	ASRQDCU	ASPIRE DOOR RAIL CONTROL MEMBER 1" I.G. DARK BRONZE
	D4	ASRQDCU	ASPIRE DOOR RAIL GLASS CLAMP 1" I.G. DARK BRONZE
	D5	ASVDSQDCU	ASPIRE VERTICAL DOOR STYLE GLASS CLAMP 1" I.G. DARK BRONZE
	D6	ASR10QMPDU	ASPIRE 12" DOOR RAIL HOUSING 1" I.G. COMPOSITE DARK BRONZE
CLAD	C1	ASDRTPCLDA	ASPIRE HEADER FOR TOP PIVOT CLADDING CLEAR ANODIZE
	C2	ASDWCCLDA	ASPIRE DOOR JAMB AT WALL CLADDING CLEAR ANODIZE
	C3	ASVMWCLDA	ASPIRE VERTICAL MULLION AT WALL CLADDING CLEAR ANODIZE
	C4	ASDRCLDA	ASPIRE 4" DOOR RAIL CLADDING 1" I.G. SS 12' CLEAR ANODIZED
	C5	ASVDRCLDA	ASPIRE VERTICAL DOOR STYLE CLADDING 1" I.G. CLEAR ANODIZE
	C6	ASDRRCLDA	ASPIRE 12" DOOR RAIL CLADDING 1" I.G. SS 12' CLEAR ANODIZE
GASKET	G1	ASBUBSEL	ASPIRE BUB SEAL FOR VERTICAL MULLIONS
	G2	ASBUDJST	ASPIRE VERTICAL DOOR STYLE CLAMP GASKET
	G3	ASR10JST	ASPIRE DOOR RAIL 1" I.G. CLAMP GASKET
	G4	9120	BLACK HEAVY DENSITY QUIET CENTER FIN PILE (0.187" x 0.392")
HARDWARE	H1	PH21MB	PHC TOP PIVOT CENTER HANG SWING
	H2	PH2ASBSS	PHC PAD ADJ. PIVOT SLIDE BLOCK ASSEMBLY FOR ASPIRE DOORS
	H3	301QHP	PHC HEAVY-DUTY ADJUSTABLE DUAL PURPOSE BOTTOM PIVOT SET
	H4	RT10SA	PHC MORTISE KEYPED CYLINDER W/ 3MM TRIM RING BATH ANODIZE
	H5	R77S	PHC STANDARD DOOR RAIL FLOOR LOCK 1 1/8" THROW
	H6	DP518S	PHC DUST PROOF KEEPER NON-LOCKING WITH PLATE BRUSHED STAINLESS STEEL
	H7	PLN2026	PLANET DROOP SEAL 90MM (3.75")
SCREWS	S1	ASDRCFST	3/8"-16 x 1-1/4" CUP POINT SET SCREW 18-8 STAINLESS ASPIRE DOOR RAIL CLAMPING FASTENER - WITH NYLON PATCH
	S2	ASDFST	ASPIRE 3/8"-16 x 1-1/2" LOW PROFILE SOCKET CAP SCREW 18-8 STAINLESS STEEL
	S3	ASBQFST	ASPIRE CORNER BLOCK FASTENERS 18-8 STAINLESS
	S4	832X718PHRQAB	5-32 x 7/16" PHILLIPS FLAT HEAD UNDERCUT 18-8 STAINLESS
	S5	ASVDSQCFST	ASPIRE #10-24 x 1/2" CONE POINT SET SCREW 18-8 STAINLESS STEEL W/ NYLON PATCH
	S6	HPG4	#6-32 x 1/4" LONG 18-8 STAINLESS STEEL HEX DRIVE FLAT HEAD SCREW
	S7	ASBQFST	ASPIRE 1/4"-28 x 3/8" SOCKET CAP SCREW 18-8 STAINLESS - CORNER BLOCK FASTENERS
	S8	822XK2ST	#10 X 2" LONG 18-8 STAINLESS STEEL PHILLIPS FLAT HEAD SCREW FOR WOOD
MISC	M1	AS1AGLS	1" THICK INSULATED TEMP GLASS PANEL: 3/16" CLEAR TEMP X 3/8" AIR SPACER X 3/16" CLEAR TEMP
	M2	VDSQCAP	ASPIRE WEATHER STRIP CAP
	M3	AS1GPHBLK	ASPIRE DOOR JACK PUSHING BLOCK
	M4	AS1CRNBLKAC	DOOR CORNER BLOCK FOR ALUMINUM CLADD ASPIRE DOOR
	M5	VNB110	PHC VNB ADHESIVE TAPE 3/16 X 1"
	M6	VNB1240	PHC VNB ADHESIVE TAPE 3/16 X 1/8" X 108' ACRYLIC VERY HI-BOND ADHESIVE TAPE
	M7	VNB11340	ACRYLIC VNB ADHESIVE TAPE 3/16 X 1-1/2
	M8	ASR40	8447 1/8" X 1-1/8" X 1/4" IN BLACK 304 STAINLESS ANTI-RUBBER STOPPER WITH POK
	M9	CGRR140	PHC BASKET FOOT CLOSED CELL 1/4" DIA
	M10	DO79BL	PHC 79S DOOR CORNER SILICONE BUILDING SEALANT - BLACK
	M11	S180C	PHC S180 SERIES ACRYLIC GURE SILICONE SEALANT - CLEAR



ENGINEER STAMP



DATE	DESCRIPTION	BY	CHKD

Drawn By: MS
Checked By:
Date: 3/3/26
Scale: AS NOTED
Project #


Sheet No.
0.01

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26
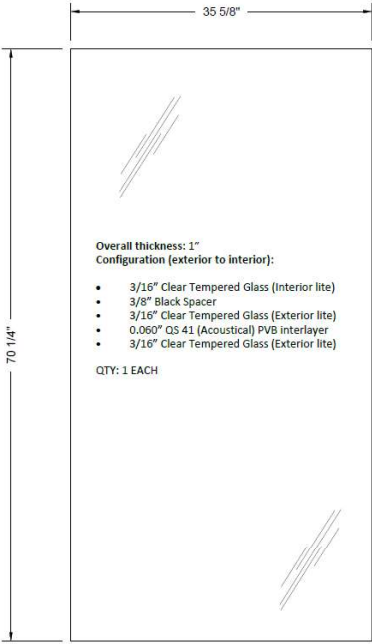
<div style="border: 1px solid black; padding: 2px;"> <p>Report #: T6273.01-303-11 Date: 05/15/2026 Verified by: </p> </div> <div style="border: 1px solid black; padding: 2px; margin-top: 5px;"> <p>TE Intertek</p> </div>	 <p style="text-align: center;">35 5/8"</p> <p style="text-align: center;">70 1/4"</p> <p style="text-align: center;">Overall thickness: 1" Configuration (exterior to interior):</p> <ul style="list-style-type: none"> 3/16" Clear Tempered Glass (Interior lite) 3/8" Black Spacer 3/16" Clear Tempered Glass (Exterior lite) 0.060" QS 41 (Acoustical) PVB interlayer 3/16" Clear Tempered Glass (Exterior lite) <p style="text-align: center;">QTY: 1 EACH</p>	<div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;">FHC <small>Intertek Building & Construction</small></p> <p style="text-align: center; font-size: small;">BUSINESS STAMP</p> <hr/> <p style="text-align: center; font-size: small;">ACUSTIC INTERIOR PARTITION</p> <p style="text-align: center; font-size: x-small;">REF: Q0002 P: NA C: NA</p> </div>
--	--	---



Total Quality. Assured.

130 Derry Court
York, Pennsylvania 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR FRAMELESS HARDWARE COMPANY LLC

Report No.: T6273.01-303-11-R1

Revision 1: 05/28/26

Date: 05/20/26

SECTION 13 REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	05/20/26	N/A	Original Report Issue
1	05/28/26	16	The last page of the drawing has been updated to reflect the actual glazing tested.